

FIRE COMPANY CERTIFICATION:

NAME & TITLE_

NATURAL RESOURCES CONSERVATION SERVICE CERTIFICATION:

NAME & TITLE_

FREEZE PROTECTION

8" PVC FROM HEAD ASS'Y TO BELOW NORMAL


WATER: ANNULAR SPACE FILLED WITH INSULATION

FOAM. (PREMOLDED OR EXPANDING FOAM)

GUARD POSTS - SEE NOTE #1

YES -- NO --

YES _____
NO _____

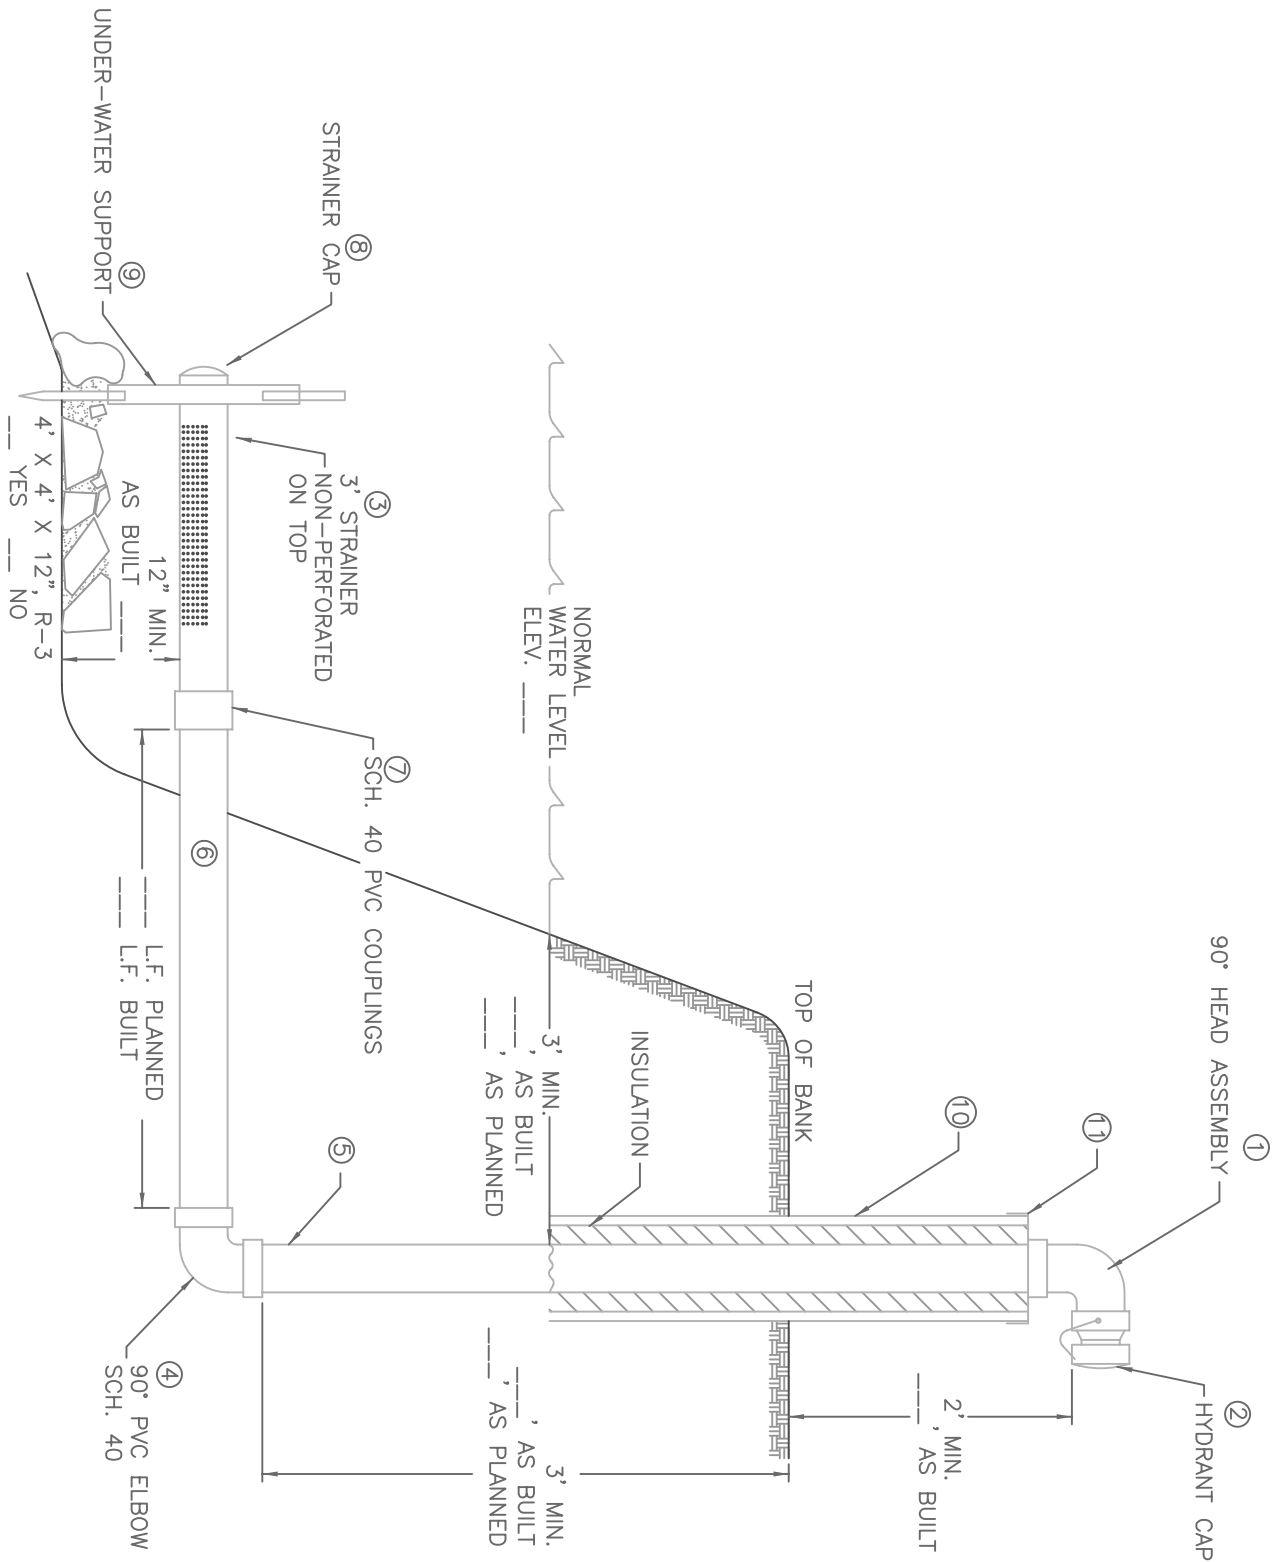

PROFILE

NOTES:

1. FOR GUARD POSTS, IF REQUIRED, SHALL BE

2. UNDER-WATER SUPPORT CAN BE COMMERCIAL KIT OR CONSTRUCTED FOR LOCAL CONDITIONS.

NOT TO SCALE

Date _____

Designed _____

Drawn _____

Checked _____

Approved by _____



_____COUNTY, PENNSYLVANIA

4" DRY HYDRANT - VERTICAL

1e No.

PA-057A.dwg

Drawing No.

PA-057A

Sheet _____ of _____